OLD FILE NAME: 099597/A1

| PREPARED BY: MAJ | SANDIA NATIONAL LABORATORIES<br>FACILITIES ENGINEERING | DETAIL NO.: AE5029 |
|---|---|---|
| CHECKED BY: ILM | | SCALE: NONE |
| DATE: 6-15-01 / REV: A | CLEARANCES FOR MULTIPLE PIPE/CONDUIT PENETRATIONS | ARCHITECTURAL STANDARD |

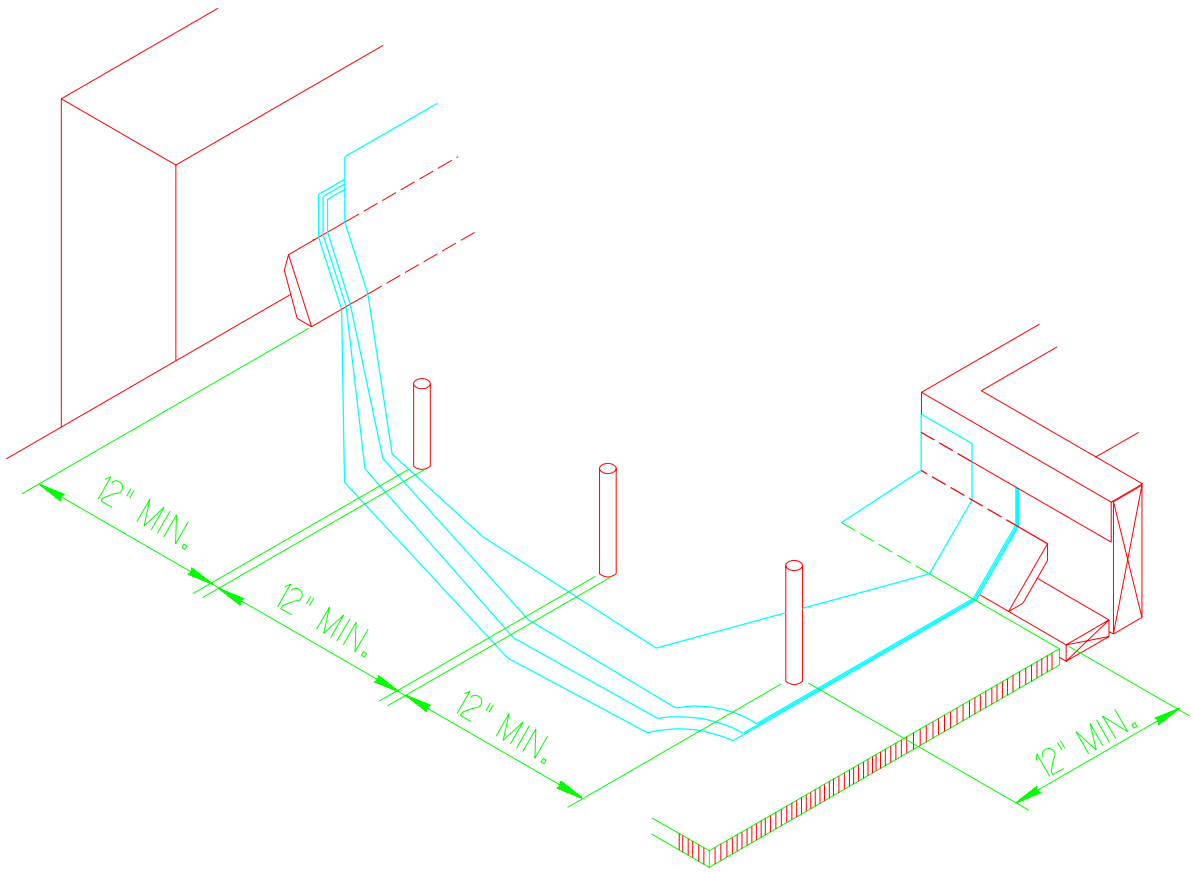


NOTES:

1. THIS DRAWING IS USED TO INDICATE MINIMUM CLEARANCES OF PIPE/CONDUIT PENETRATIONS TO PARAPET WALLS, CURBS, OR MULTIPLE PENETRATIONS. FLASHING OF PIPE/CONDUIT SPECIFIED ELSEWHERE.

2. THESE CLEARANCES BETWEEN PIPES/CONDUITS ARE NOT APPLICABLE IF MULTIPLE ROOF PENETRATION SEAL IS SPECIFIED BY ARCH. STD. DRAWING #99518.

"Property of Sandia National Laboratories Facilities Management and Operation Center (FMOC).
No duplication or alteration allowed without the expressed permission and authorization of FMOC."