


REV:	
PREPARED BY:	
CHECKED BY:	
DATE:	
REV:	D
PREPARED BY:	P.S
CHECKED BY:	D.S
DATE:	10-08
REV:	C
PREPARED BY:	J.G
CHECKED BY:	D.S
DATE:	12-05

SANDIA NATIONAL LABORATORIES
FACILITIES ENGINEERING

DRAWING NO.:	MP5037
SCALE:	NONE
	MECHANICAL

HOT WATER BOILER PIPING

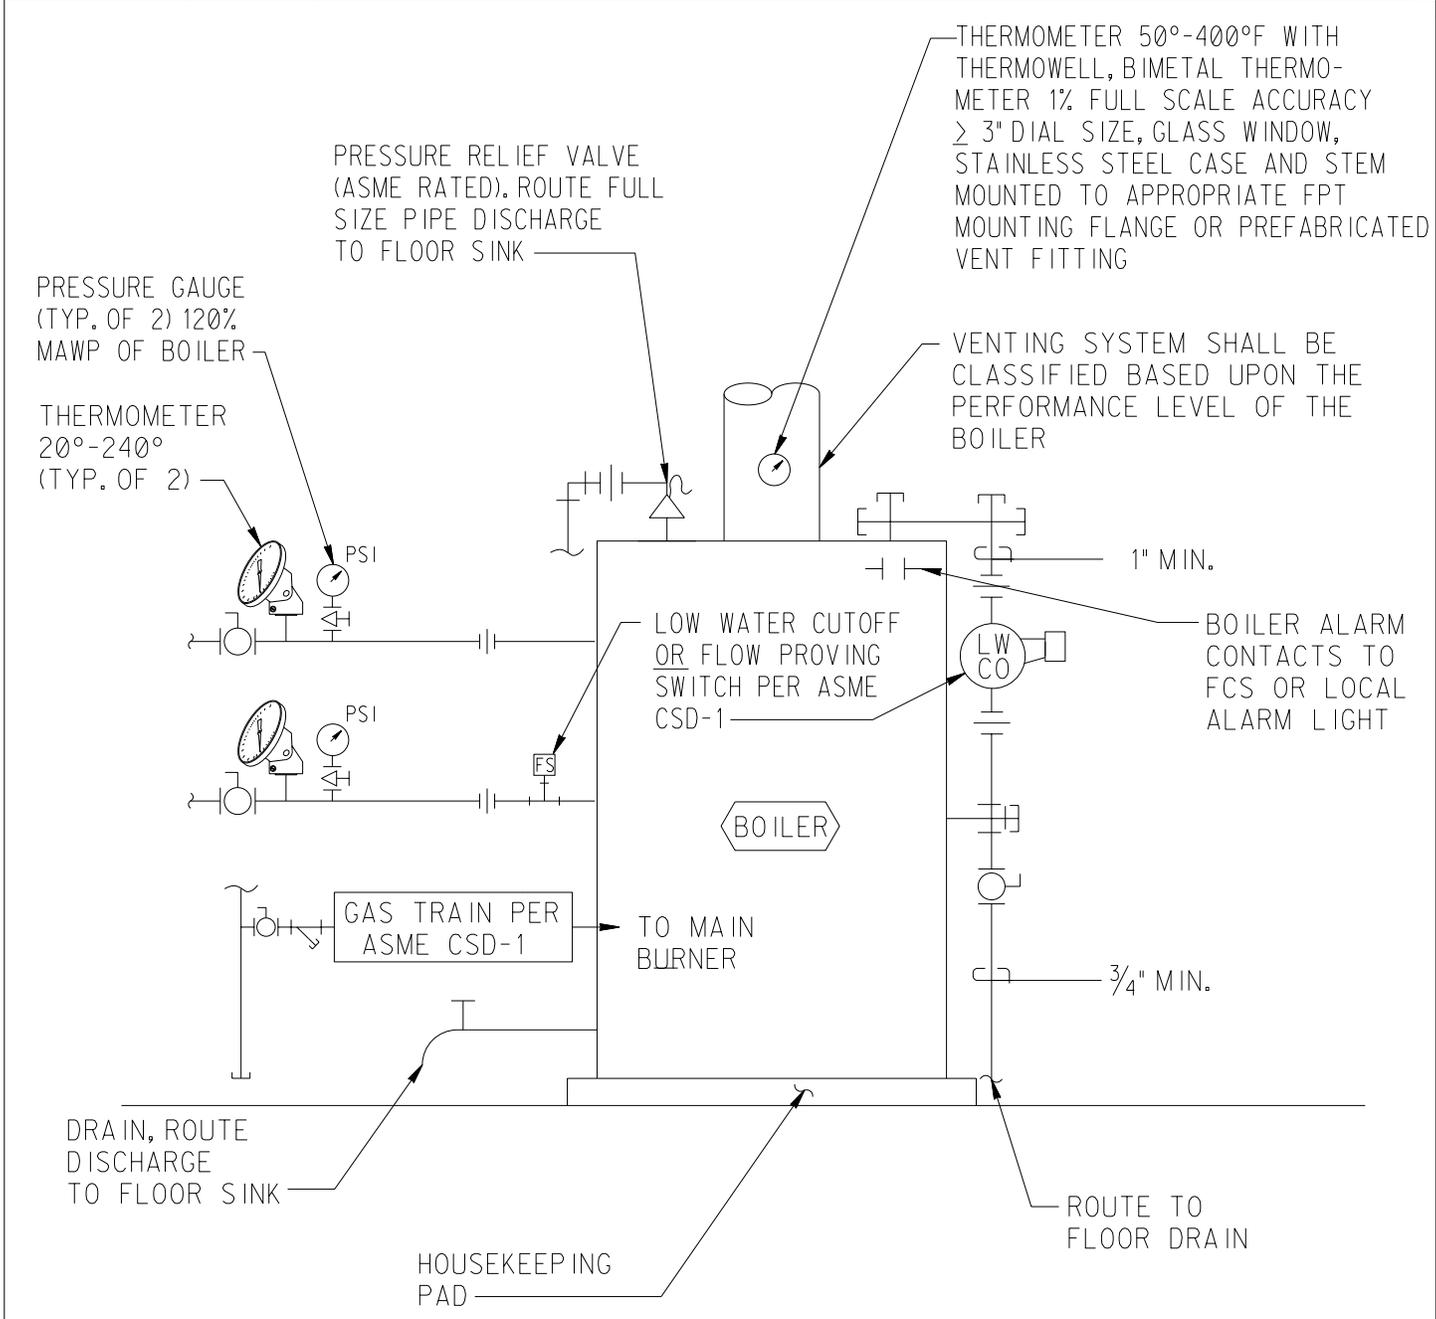

NOTE:
A MANUALLY OPERATED REMOTE SHUTDOWN SWITCH SHALL BE LOCATED JUST OUTSIDE THE BOILER ROOM DOOR AND MARKED FOR EASY IDENTIFICATION. IF THE BOILER ROOM DOOR IS ON THE BUILDING EXTERIOR, THE SWITCH SHOULD BE LOCATED JUST INSIDE THE DOOR.