

OLD FILE NAME:

DRAWING NO.:

**PL5004**

SCALE:


**NONE**

**MECH  
DISCIPLINE**

REV:	
PREPARED BY:	
CHECKED BY:	
DATE:	
REV:	<b>1</b>
PREPARED BY:	<b>JWR</b>
CHECKED BY:	<b>DS</b>
DATE:	<b>8/06/07</b>
REV:	
PREPARED BY:	
CHECKED BY:	
DATE:	<b>6/15/07</b>

# SANDIA NATIONAL LABORATORIES FACILITIES ENGINEERING

## SAFETY SHOWER INSTALLATION

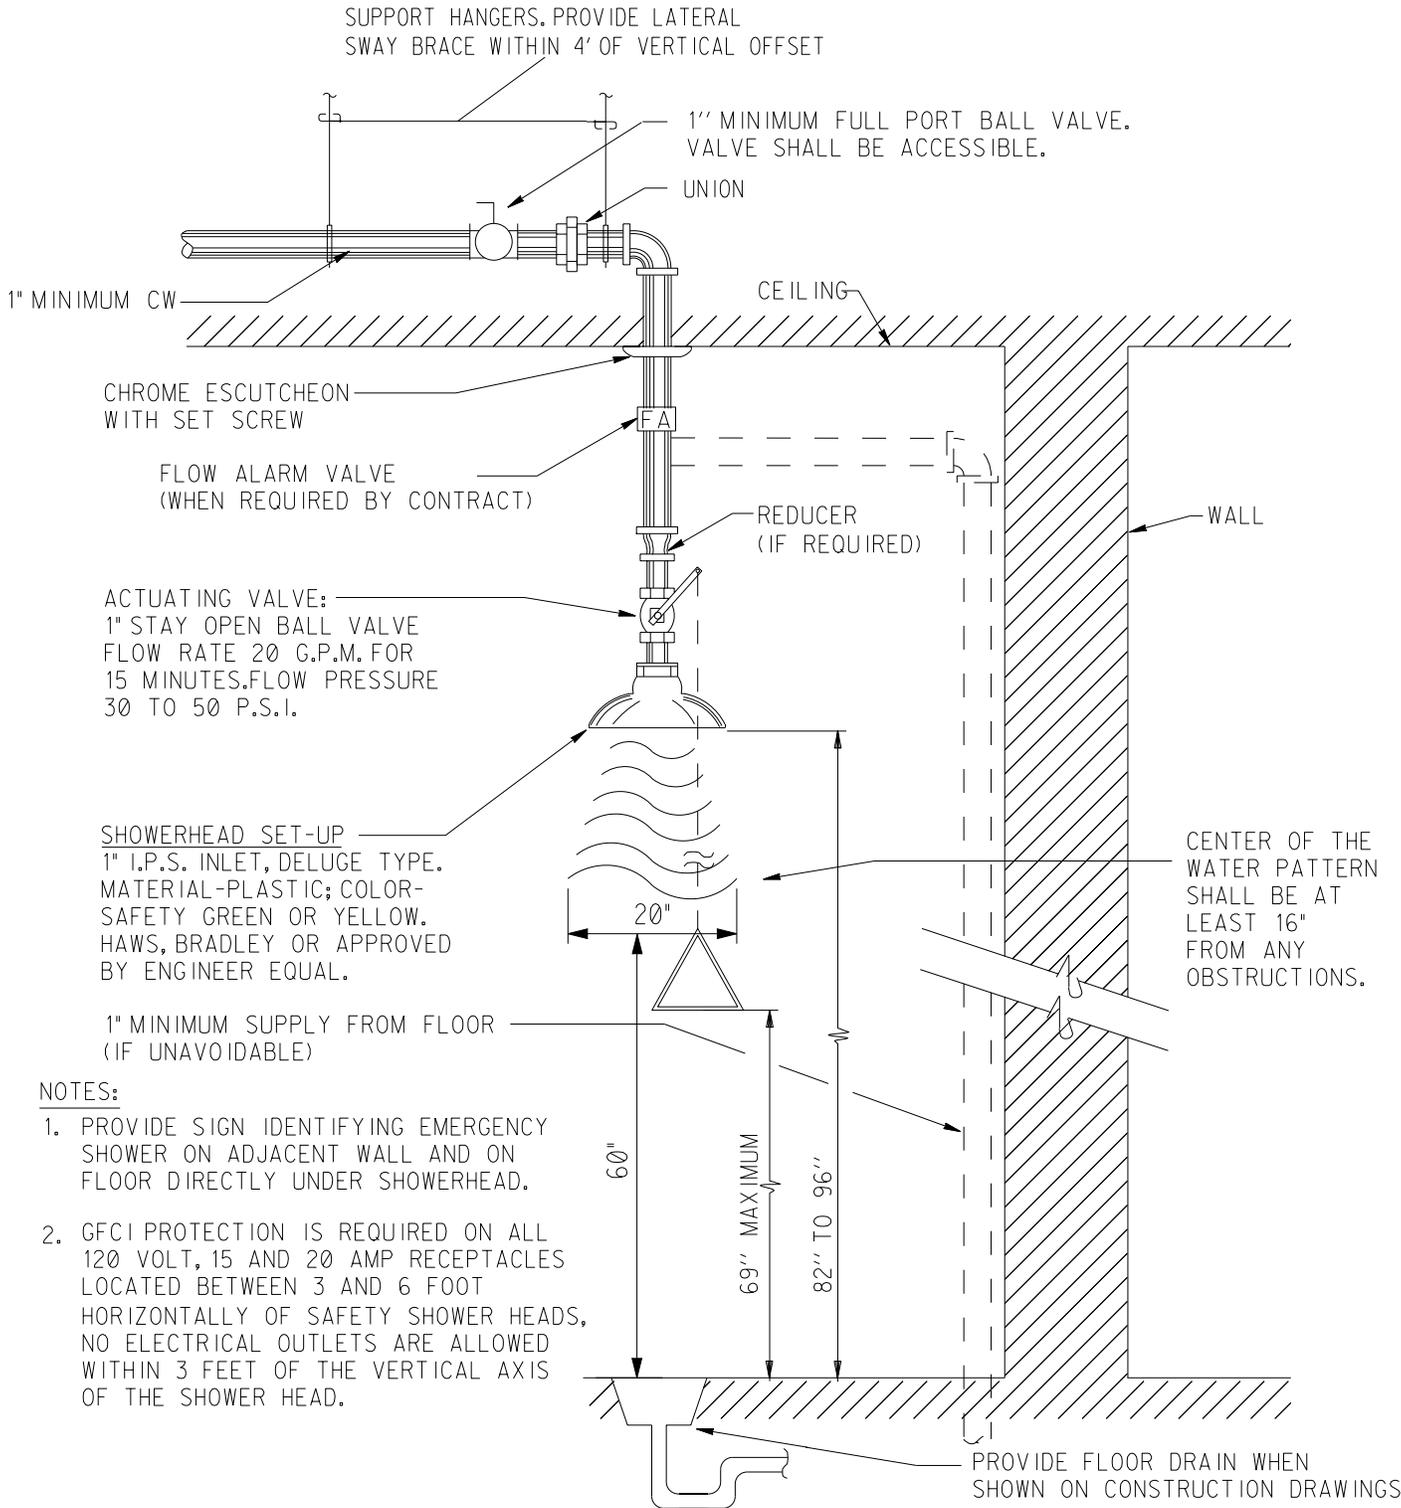

**NOTES:**

1. PROVIDE SIGN IDENTIFYING EMERGENCY SHOWER ON ADJACENT WALL AND ON FLOOR DIRECTLY UNDER SHOWERHEAD.
2. GFCI PROTECTION IS REQUIRED ON ALL 120 VOLT, 15 AND 20 AMP RECEPTACLES LOCATED BETWEEN 3 AND 6 FOOT HORIZONTALLY OF SAFETY SHOWER HEADS, NO ELECTRICAL OUTLETS ARE ALLOWED WITHIN 3 FEET OF THE VERTICAL AXIS OF THE SHOWER HEAD.

Property of Sandia National Laboratories Facilities Management and Operation Center (FMOC). No duplication or alteration allowed without the expressed permission and authorization of FMOC.