



GENERAL NOTES

1. THESE DETAILS REFER ONLY TO INSTALLATIONS ON FLEXIBLE PIPE MAINS. REFER TO OTHER APPROPRIATE STANDARDS FOR RIGID PIPE MAINS.
2. DETAIL "A" SHALL BE USED WHEN A TRENCH BOX, SHORING OR OTHER MEANS OF EXCAVATION BRACING IS USED. OTHERWISE IT SHALL BE THE CONTRACTOR'S OPTION TO USE EITHER DETAIL "A" OR DETAIL "B".
3. REFER TO SNL STANDARD SPECIFICATIONS FOR MATERIAL REQUIREMENTS.

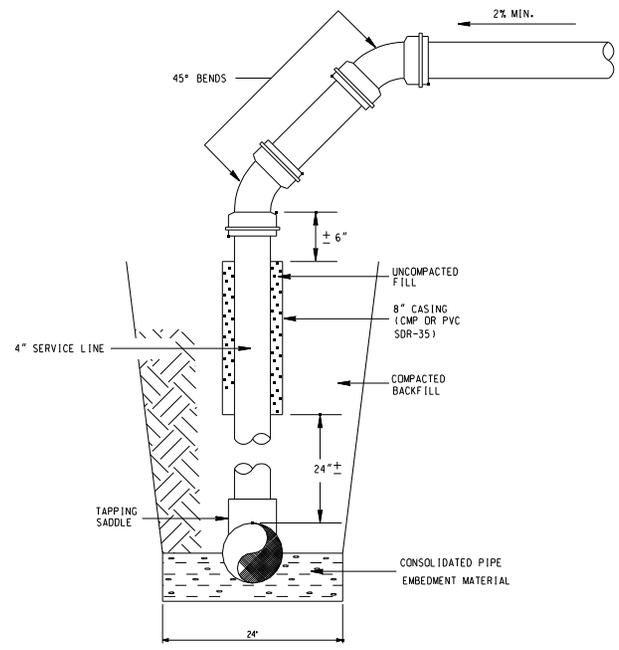

DETAIL "A"

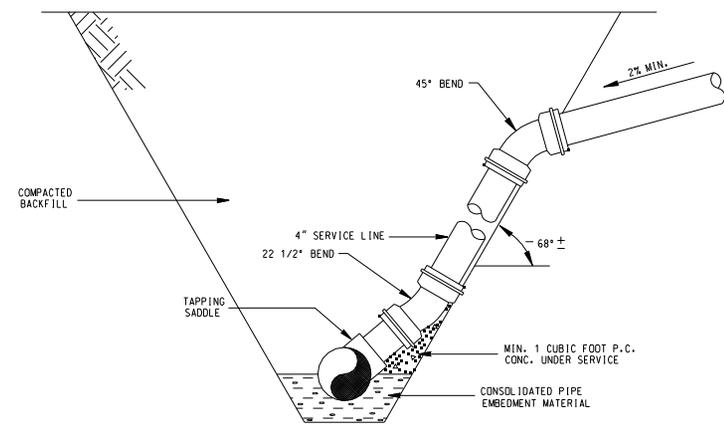

DETAIL "B"

P.O.	PROJECT NO.	REV	DATE	DESCRIPTION	DRN	CKD	APP
NNSA/SANDIA SITE OFFICE				ALBUQUERQUE, NEW MEXICO			
<b>SANDIA NATIONAL LABORATORIES</b>							
SANITARY RISER FLEXIBLE PIPE MAIN				P.O.			
				PROJECT NO.			
				DRAWN BY	LJ/BER		
				CHECKED BY	JM/MICHAELS		
				SNL ENGR	MADAMS		
DISCP: M	SUB-DISCP: R	STD	DATE	07/19/2007			
OLD FILENAME: WSS005STD.DGN				SIZE	DRAWING NO	FILENAME	WSS005STD.DGN
				D+			

Property of Sandia National Laboratories Facilities Management and Operation Center (FMOC). No duplication, or use of any, contents, or information, is permitted without the express permission and written contract of FMOC.