

REV:	
PREPARED BY:	
CHECKED BY:	
DATE:	
REV:	<b>B</b>
PREPARED BY:	<b>PS</b>
CHECKED BY:	<b>JMM</b>
DATE:	<b>3/08</b>
REV:	<b>A</b>
PREPARED BY:	<b>ESM</b>
CHECKED BY:	<b>DMR</b>
DATE:	<b>7/02</b>

SANDIA NATIONAL LABORATORIES  
FACILITIES ENGINEERING


DRAWING NO.:	<b>WW3002</b>
SCALE:	<b>NONE</b>
	<b>CIVIL DISCIPLINE</b>

**VALVE & POST INDICATOR  
STEEL OR CAST-IRON**

PAINT NOTES:

ABOVE GRADE: TWO COATS OF SUITABLE ALKYD ENAMEL PAINT, COATING SHALL BE SHERWIN-WILLIAMS COMPANY KEM AQUA 400 WATERBORNE ENAMEL OR APPROVED EQUAL. INDICATOR POST SHALL BE FIRE PROTECTION RED (S-W:CONTAINER RED) FOR FIRE SPRINKLER LINES, OR TRAFFIC YELLOW (S-W: FEDERAL YELLOW) FOR DISTRIBUTION SYSTEM INDICATOR VALVES.

BELOW GRADE: TWO COATS OF ASPHALT VARNISH.

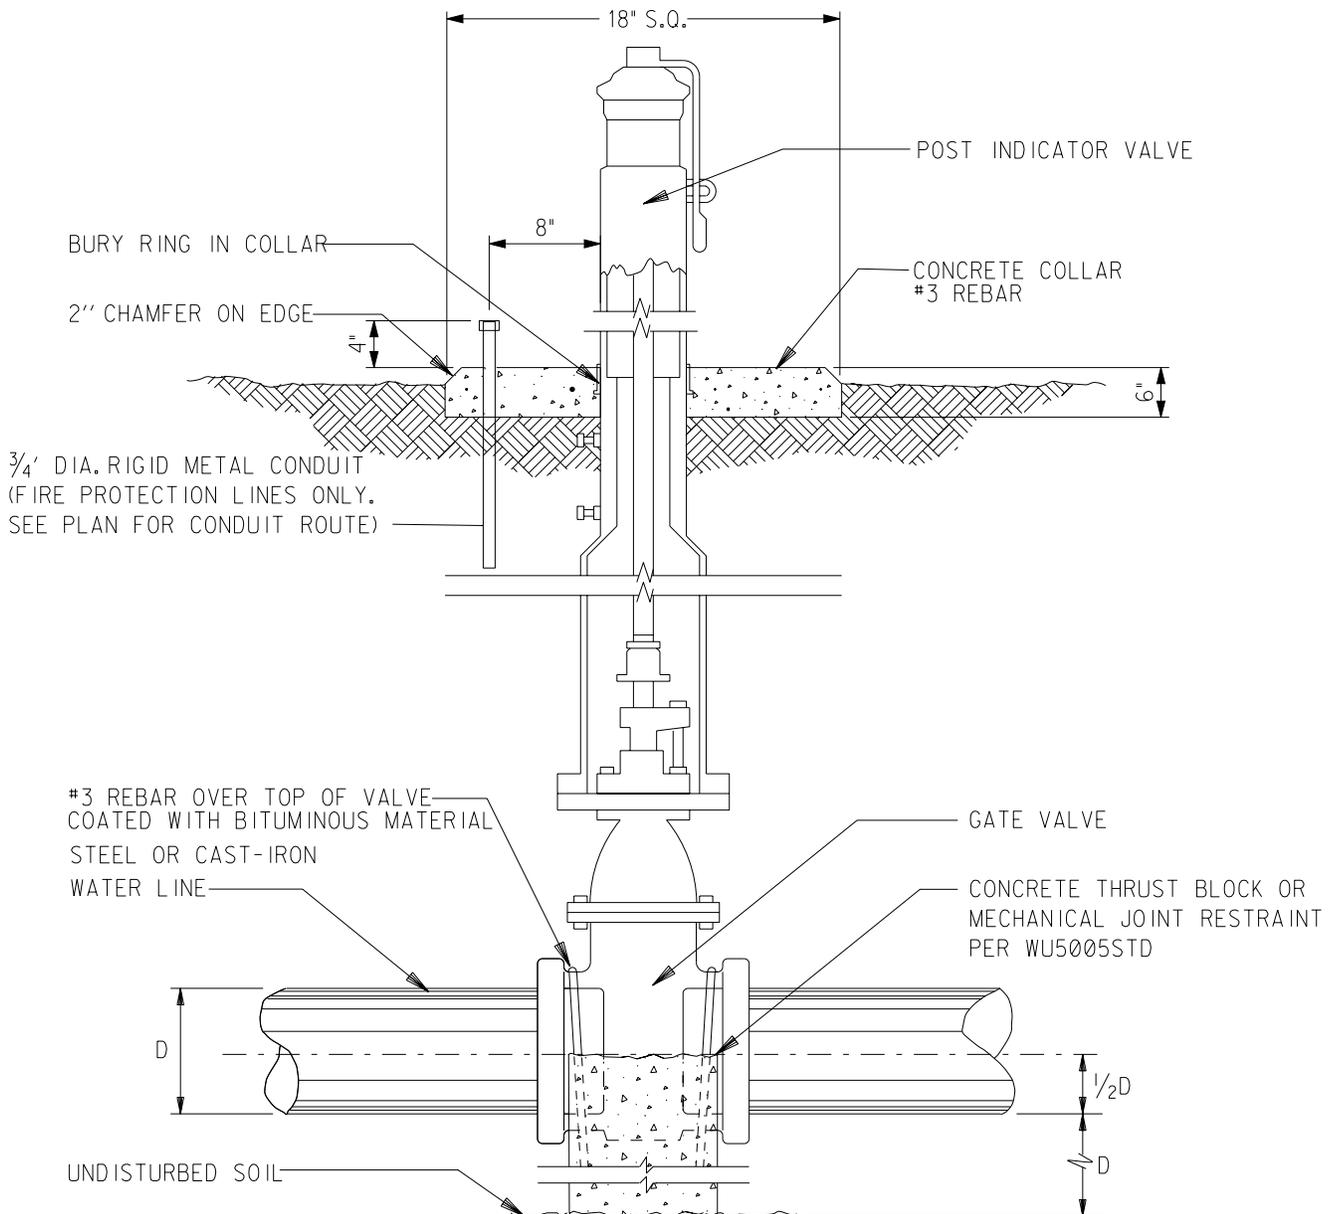

Property of Sandia National Laboratories Facilities Management and Operation Center (FMOC). No duplication or alteration allowed without the expressed permission and authorization of FMOC.